




Meter Location Guidelines

Prohibited MSA Locations

The following are not acceptable:

- Inside living quarters of any building
- Within 8' horizontal of an air intake
- Under fire escapes or stairways
- Anywhere corrosive substances may come in contact
- In any room containing a source of ignition i.e. (electrical equipment, boilers, engine rooms, ect.)
- Within 5' of a source ignition
- Any Unventilated area

METER LOCATION CODES	
A-Alley	N-No
B-Back or Rear	O-Out
C-Curb	P-Porch
D-Door (knock & enter)	Q-Fence Read
F-Front	R-Right
G-Garage	S-Stairs/Steps
H-House or Building	T-Top or Up
I-In	U-Under
J-Basement	V-Vault or CMB
K-Key	W-Window
KK-Lockbox	X-Dog
L-Left	XX-Bad dog
M-Middle	Y-Yard
	Z-Special

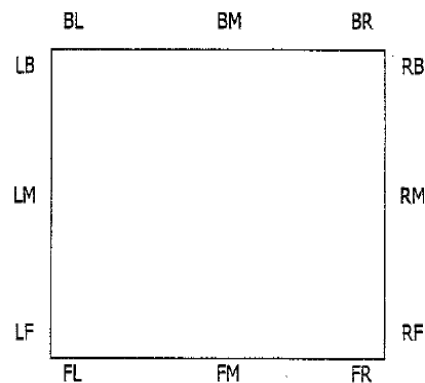

The Operations Manager and General Manager provide interpretation of this document and may allow exceptions where operating needs justify them.